

## Portable Manual Handle Type Pulse Generators

# ENHP Series

## INSTRUCTION MANUAL

TCD210032AA

**Autonics**

Thank you for choosing our Autonics product.

**Read and understand the instruction manual and manual thoroughly before using the product.**

**For your safety, read and follow the below safety considerations before using.**

**For your safety, read and follow the considerations written in the instruction manual, other manuals and Autonics website.**

Keep this instruction manual in a place where you can find easily.

The specifications, dimensions, etc. are subject to change without notice for product improvement. Some models may be discontinued without notice.

Follow Autonics website for the latest information.

### Safety Considerations

- Observe all 'Safety Considerations' for safe and proper operation to avoid hazards.
- ⚠ symbol indicates caution due to special circumstances in which hazards may occur.

**⚠ Warning** Failure to follow instructions may result in serious injury or death.

**01. Fail-safe device must be installed when using the unit with machinery that may cause serious injury or substantial economic loss. (e.g. nuclear power control, medical equipment, ships, vehicles, railways, aircraft, combustion apparatus, safety equipment, crime / disaster prevention devices, etc.)**  
Failure to follow this instruction may result in personal injury, economic loss or fire.

**02. Do not use the unit in the place where flammable / explosive / corrosive gas, high humidity, direct sunlight, radiant heat, vibration, impact or salinity may be present.**  
Failure to follow this instruction may result in explosion or fire.

**03. Install on a device panel to use.**

Failure to follow this instruction may result in fire.

**04. Do not connect, repair, or inspect the unit while connected to a power source.**

Failure to follow this instruction may result in fire.

**05. Check 'Connections' before wiring.**

Failure to follow this instruction may result in fire.

**06. Do not disassemble or modify the unit.**

Failure to follow this instruction may result in fire.

**⚠ Caution** Failure to follow instructions may result in injury or product damage.

**01. Use the unit within the rated specifications.**

Failure to follow this instruction may result in fire or product damage.

**02. Do not short the load.**

Failure to follow this instruction may result in fire.

**03. Do not use the unit near the place where there is the equipment which generates strong magnetic force or high frequency noise and strong alkaline, strong acidic exists.**

Failure to follow this instruction may result in product damage.

### Cautions during Use

- Follow instructions in 'Cautions during Use'. Otherwise, it may cause unexpected accidents.
- 5 VDC≐, 12 - 24 VDC≐ power supply should be insulated and limited voltage / current or Class 2, SELV power supply device.
- For using the unit with the equipment which generates noise (switching regulator, inverter, servo motor, etc.), ground the shield wire to the F.G. terminal.
- Ground the shield wire to the F.G. terminal.
- When supplying power with SMPS, ground the F.G. terminal and connect the noise canceling capacitor between the 0 V and F.G. terminals.
- Wire as short as possible and keep away from high voltage lines or power lines, to prevent inductive noise.
- For Line driver unit, use the twisted pair wire which is attached seal and use the receiver for RS-422A communication.
- Check the wire type and response frequency when extending wire because of distortion of waveform or residual voltage increment etc. by line resistance or capacity between lines.
- This unit may be used in the following environments.
  - Indoors (in the environment condition rated in 'Specifications')
  - Altitude max. 2,000 m
  - Pollution degree 2
  - Installation category II

### Cautions during Installation

- Install the unit correctly with the usage environment, location, and the designated specifications.
- When fixing the product with a wrench, tighten under 0.15 N m.

### Ordering Information

This is only for reference, the actual product does not support all combinations. For selecting the specified model, follow the Autonics website.

**ENHP - 100 - ① - ② - ③**

#### ① Click stopper position

- Normal "H"
- Normal "L"

#### ② Control output

- T: Totem pole output  
L: Line driver output

#### ③ Power supply

- 5 VDC≐ ±5%
- 24: 12 - 24 VDC≐ ±5%


### Product Components

- Product
- Instruction manual

### Connections

- Unused wires must be insulated.
- The metal case and shield cable of encoders must be grounded (F.G.).
- COMMON terminal (PIN No. 16) of Axis select switch and Rate select switch is common.

#### ■ D-SUB connector 25-pin layout



Pin	Color	Function	
1	Yellow	OUT A	
2	LT. Violet	OUT $\bar{A}$	
3	White	OUT B	
4	Clear	OUT $\bar{B}$	
5	Black	GND	
6	Red	+V	
-	Shield	F.G.	
8	Green	E-STOP1	
9	LT. Green	E-STOP1	
22	Pink	E-STOP2	
24	Grass Green	E-STOP2	
10	Violet	ENABLE switch	
11	Brown	Rate select switch	Feed rate select
12	LT. Brown	Rate select switch	Feed rate select
13	Orange	Axis select switch	Axis select
14	LT. Blue		
15	Blue	Axis select switch	Axis select
16	LT. Yellow	BCD COMMON	BCD COMMON
18	Gray	Indicator	LED (+)

#### ■ Rate select switch

Rate	BCD Code	
	Pin No. 12	Pin No. 11
R1	0	0
R2	0	1
R3	1	0
R4	1	1


#### ■ Axis select switch

Axis	BCD Code		
	Pin No. 15	Pin No. 14	Pin No. 13
OFF	0	0	0
X	0	0	1
Y	0	1	0
Z	0	1	1
A	1	0	0
B	1	0	1


### Inner Circuit

- Output circuits are identical for all output phase.

#### ■ Totem pole output




#### ■ Line driver output




### Output Waveform

- The rotation direction is based on facing the shaft, and it is clockwise (CW) when rotating to the right.
- Phase difference between A and B:  $\frac{T}{4} \pm \frac{T}{8}$  (T = 1 cycle of A)
- Click stopper position Normal "H" or Normal "L"  
: It shows the waveform when the handle is stopped.

#### ■ Totem pole / Voltage output

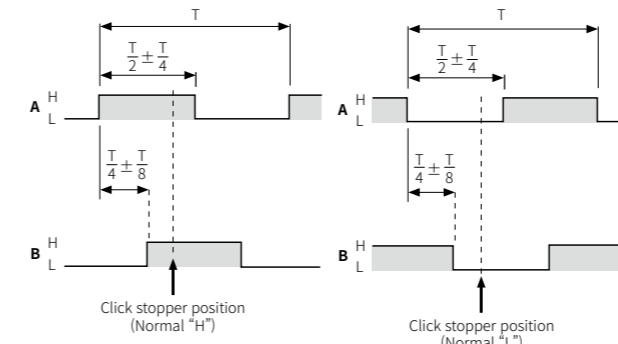

#### ■ Line driver output

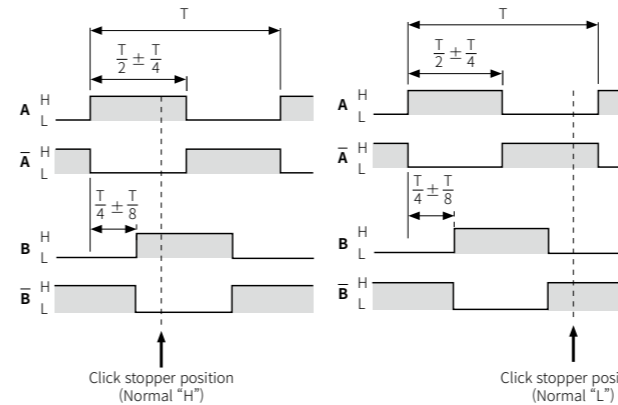

### Specifications

Model	ENHP-100-□-T-□	ENHP-100-□-L-5
Resolution	100 PPR	
Control output	Totem pole output	Line driver output
Output phase	A, B	A, $\bar{A}$ , B, $\bar{B}$
Rotary switch output	BCD code: Rate select switch (R1, R2, R3, R4) Axis select switch (OFF, X, Y, Z, A, B)	
Inflow current	≤ 30 mA	≤ 20 mA
Residual voltage	≤ 0.4 VDC≐	≤ 0.5 VDC≐
Outflow current	≤ 10 mA	≤ -20 mA
Output voltage (5 VDC≐)	≥ (power supply -2.0) VDC≐	≥ 2.5 VDC≐
Output voltage (12 - 24 VDC≐)	≥ (power supply -3.0) VDC≐	-
Response speed <sup>01)</sup>	≤ 1 μs	≤ 0.5 μs
Max. response freq.	10 kHz	
Max. allowable revolution <sup>02)</sup>	Normal: ≤ 200 rpm, Peak: ≤ 600 rpm	
Starting torque	≤ 0.098 N m	
Allowable shaft load	Radial: ≤ 2 kgf, Thrust: ≤ 1 kgf	
Unit weight	≈ 730 g	
Approval	C E ENEC	ENEC

01) Based on cable length: 1 m, I sink: 20 mA


02) Select resolution to satisfy Max. allowable revolution ≥ Max. response revolution  
[max. response revolution (rpm) =  $\frac{\text{max. response frequency}}{\text{resolution}} \times 60 \text{ sec}$ ]

Model	ENHP-100-□-T-□	ENHP-100-□-L-5
Power supply	5 VDC≐ ± 5% (ripple P-P: ≤ 5%) / 12 - 24 VDC≐ ± 5% (ripple P-P: ≤ 5%) model	5 VDC≐ ± 5% (ripple P-P: ≤ 5%)
Current consumption	≤ 40 mA (no load)	≤ 50 mA (no load)
Insulation resistance	Between all terminals and case: ≥ 100 MΩ (500 VDC≐ megger)	
Dielectric strength	Between all terminals and case: 750 VAC~ 50 / 60 Hz for 1 minute	
Vibration	1 mm double amplitude at frequency 10 to 55 Hz (for 1 minute) in each X, Y, Z direction for 2 hours	
Shock	≤ 50 G	
Ambient temp.	-10 to 70 °C, storage: -25 to 85 °C (no freezing or condensation)	
Ambient humi.	35 to 85%RH, storage: 35 to 90%RH (no freezing or condensation)	
Protection rating <sup>01)</sup>	IP67 (IEC standard)	
Connection	connector type	
Cable spec.	Ø 5 mm, 18-wire, 8 m, spring code cable	
Wire spec.	AWG28 (0.08 mm, 18-core), insulator diameter: Ø 0.7 mm	
Connector spec.	25-pin D-SUB	

01) It is protection for the back case and the wiring part.

### Dimensions

- Unit: mm, For the detailed drawings, follow the Autonics website.

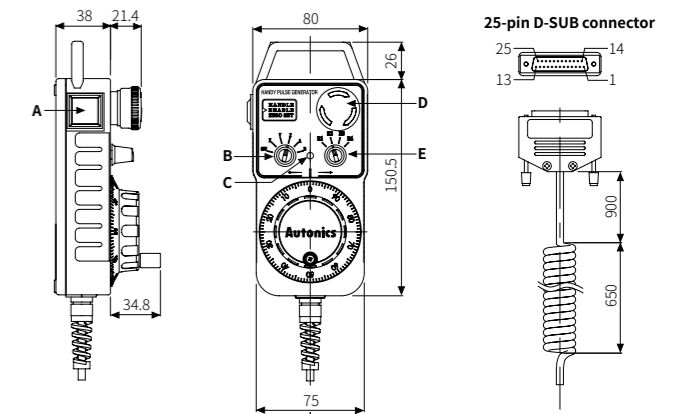

<b>A</b>	ENABLE switch	<b>C</b>	Indicator	<b>E</b>	Rate select switch
<b>B</b>	Axis select switch	<b>D</b>	Emergency stop switch		